


SLEEPING GIANT APTS

1238 HARTFORD TPKE (RT 30)

PG 79

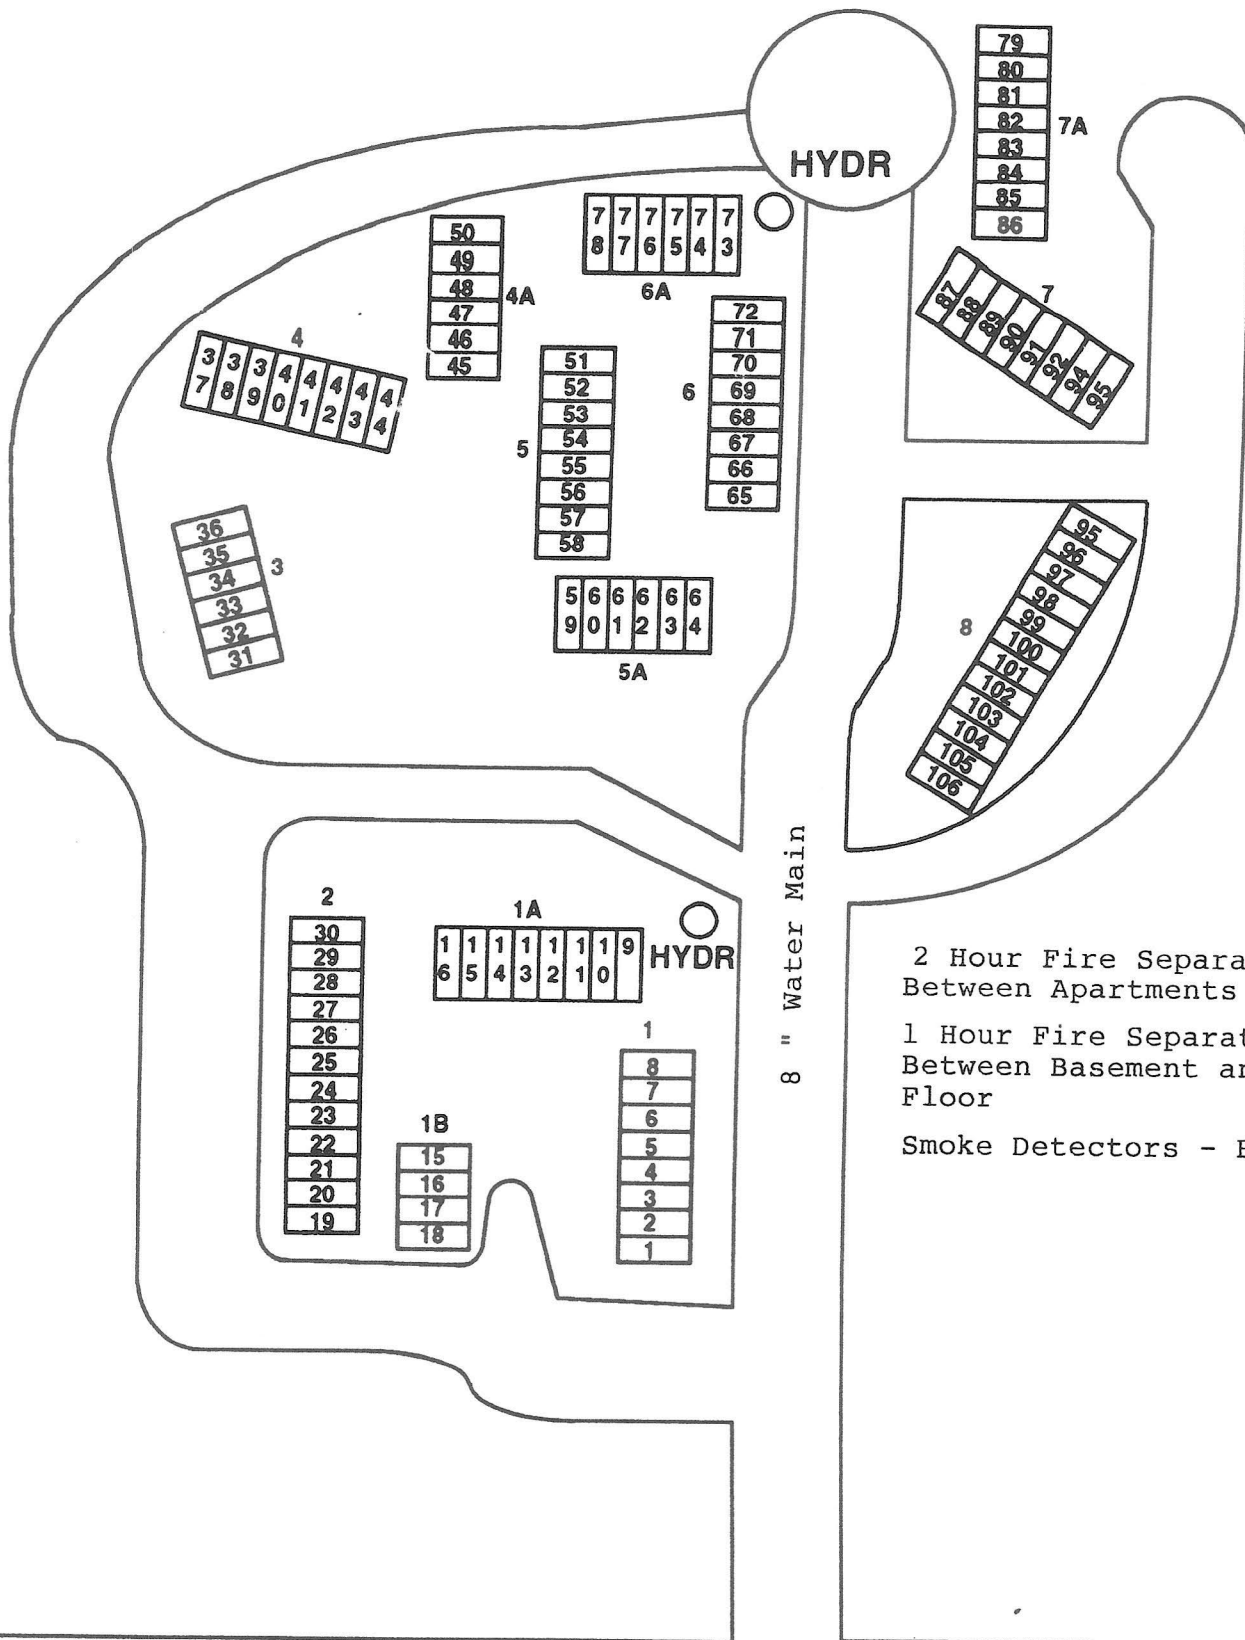

2 Hour Fire Separation
Between Apartments

1 Hour Fire Separation
Between Basement and Upper
Floor

Smoke Detectors - Battery Type

RT 30

16" Water MaIN