


# SOUTHGATE APTS

275-281 SOUTH ST

2 Hour Fire Separation  
Between Apartments

1 Hour Fire Separation  
Between Basement and Upper  
Floor

Smoke Detectors - Battery  
Type

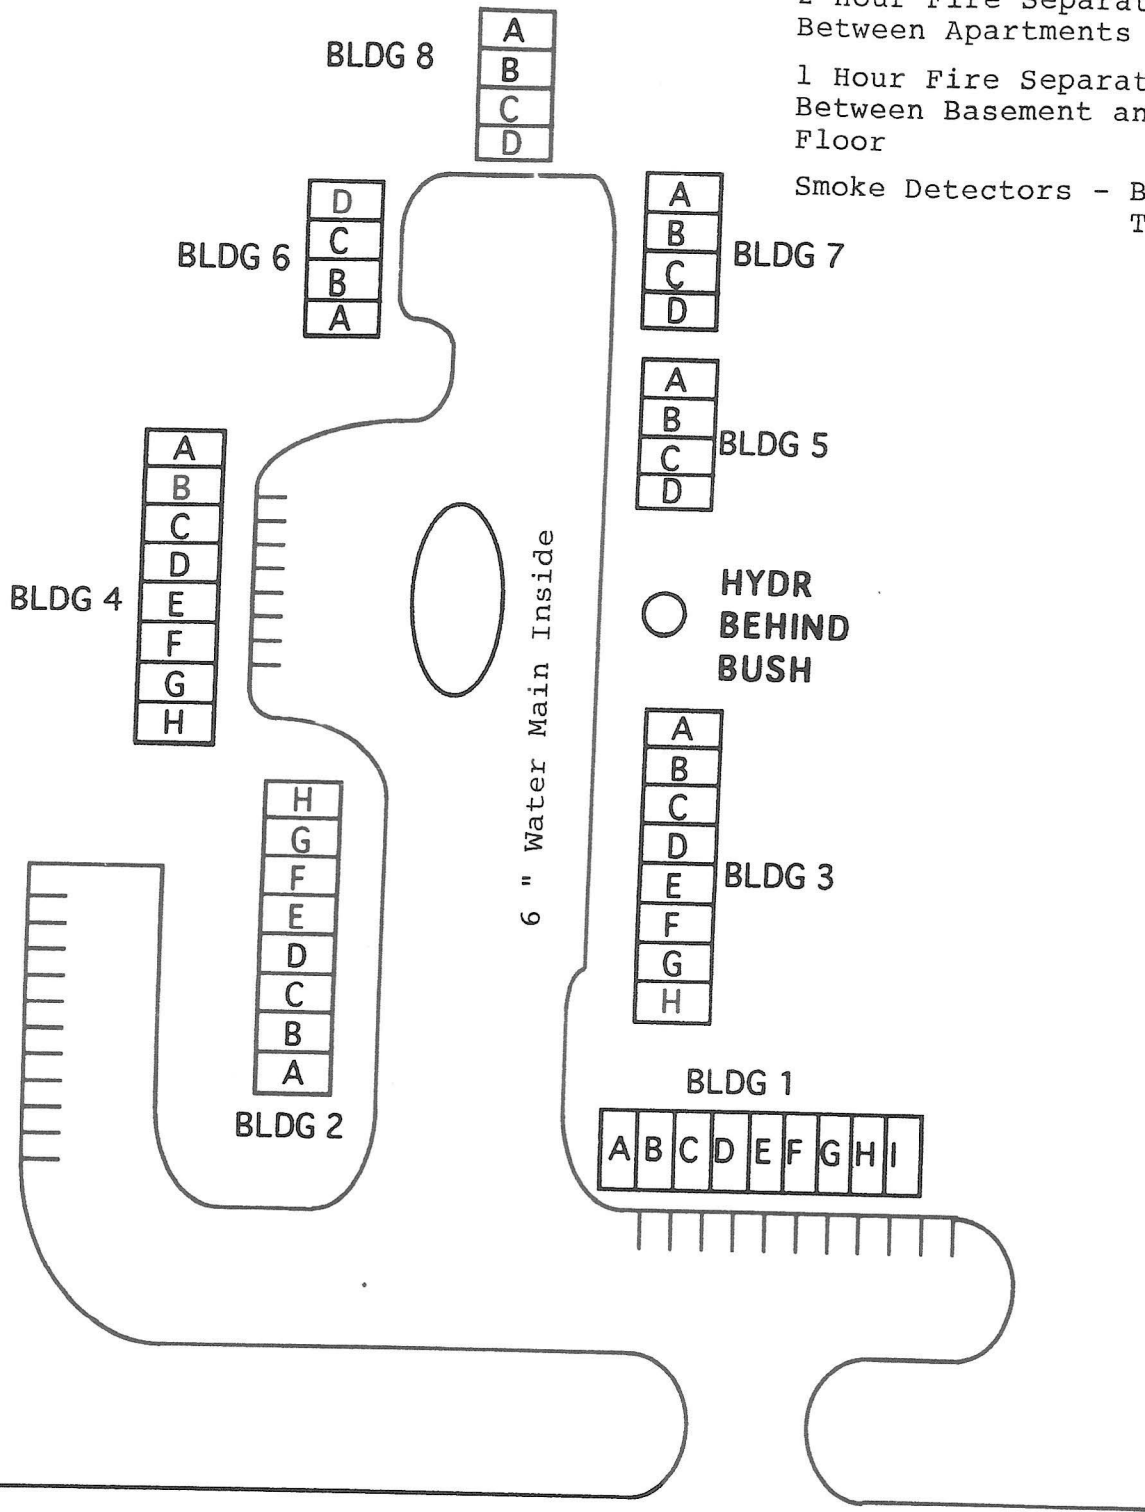

**SOUTH STREET**

10" Water Main

○  
HYDR  
265

○  
HYDR  
295